



MOTORTRONICS™

Solid State AC Motor Control

VMX-Synergy Plus™

ANSI - QUICK START GUIDE

200 - 600V, 18 - 1250 Amps



- Removable 3.5" Color Touch Screen rated IP66/N4X
- 42 Smart Application profiles - easy setup in 1 minute
- Auto Pedestal to control spinning motors
- Built-in iERS – intelligent Energy Recovery System
- 65kA rating with breakers
- Advanced motor protection with memory
- Life Time Event Logging Diagnostics
- Metering for power, voltage and current
- Integral Bypass



Intelligent Energy Recovery (iERS)

iERS can produce energy savings in suitable applications. However, the user should have an understanding of the application and load characteristic before enabling the feature.

Loads which exhibit frequent changes in motor torque may cause the VMX-Synergy Plus™ to switch rapidly between the iERS on state and the 'bypassed' state as the motor torque changes. If left unchecked, such switching may cause premature wear of the internal bypass components and may invalidate the warranty.

If the loaded / unloaded state changes more than 4 times per minute, iERS should not be enabled.

Applications that are typically well suited to the iERS feature include; Artificial Lift Pump Jacks, Injection Molding Machines, Mixers, Saws, Rolling Mills, Grinders, Hydraulic Pumps, Crushers, Conveyors, Compressors and Vertical Transport applications.

If the user requires further support regarding the suitability of the application, he should seek support from Motortronics Inc or an Authorized Distributor before enabling the iERS function.



Safety

Important information

Installers should read and understand the instructions in this guide prior to installing, operating and maintaining the soft start. The following symbols may appear in this guide or on the soft start to warn of potential hazards or to draw attention to certain information.



Dangerous Voltage

Indicates the presence of a hazardous voltage which could result in personal injury or death.

Tension dangereuse

Indique la présence d'une tension dangereuse qui peut entraîner des blessures ou la mort.



Warning/Caution

Indicates a potential hazard. Any instructions that follow this symbol should be obeyed to avoid possible damage to the equipment, and personal injury or death.

Avertissement/Mise en garde

Indique un danger potentiel. Toutes les instructions suivant ce symbole doivent être observées, afin d'éviter les dommages de l'équipement et les blessures ou la mort.

Protective Earth (Ground)

Indicates a terminal which is intended for connection to an external conductor for protection against electric shock in case of a fault.

Mise à la terre (Masse)

Indique une borne dont l'usage prévu est d'être connecter à conducteur externe pour assurer la protection contre les chocs électriques en cas de défauts.

Caution Statements

The examples and diagrams in this manual are included solely for illustrative purposes. The information contained in this manual is subject to change at any time and without prior notice. In no event will responsibility or liability be accepted for direct, indirect or consequential damages resulting from the use or application of this equipment.

Mises en garde

Les exemples et les schémas de ce manuel ne sont donnés qu'à titre illustratif. Les informations présentées dans ce manuel peuvent être modifiées sans avis préalable. En aucun cas nous n'assumons la responsabilité ou l'obligation pour les dommages directs, indirects ou consécutifs qui résultent de l'utilisation ou application de cet équipement.

Short Circuit

Motortronics soft starts are not short circuit proof. After severe overload or short circuit, the operation of the soft start should be fully tested by an authorized service agent.

Court-circuit

Les démarreurs progressifs Motortronics ne sont pas à l'épreuve des courts-circuits. Après une forte surcharge ou un court-circuit, le fonctionnement du démarreur progressif doit être intégralement vérifié par un agent de maintenance agréé.

Safety



- VMX-Synergy Plus™ soft starts contain dangerous voltages when connected to the mains supply. Only qualified personnel that have been completely trained and authorized, should carry out installation, operation and maintenance of this equipment.

- Les démarreurs progressifs VMX-Synergy Plus™ contiennent des tensions dangereuses, lorsqu'ils sont connectés à la tension secteur. Les activités d'installation, d'utilisation et d'entretien de cet équipement doivent être effectuées par un personnel qualifié, dûment formé et habilité.

- Installation of the soft start must be made in accordance with existing local and national electrical codes and regulations and have a minimum protection rating.

- Le démarreur progressif doit être installé conformément au code local et nationale d'électricité et à la réglementation en vigueur, et il doit avoir un indice de protection minimal

- It is the responsibility of the installer to provide suitable grounding and branch circuit protection in accordance with local electrical safety codes.


- Il appartient à l'installateur d'assurer la mise à la terre et la protection du circuit de branchement, conformément au code de sécurité électrique local.

- This soft start contains no serviceable or re-usable parts.

- Ce démarreur progressif ne contient pas de pièces réparables ou réutilisables

- The STOP function of the soft start does not isolate dangerous voltages from the output of the soft start. An approved electrical isolation device must be used to disconnect the soft start from the incoming supply before accessing electrical connections.


- La fonction STOP du démarreur progressif n'isole pas les tension dangereuses en sortie du démarreur progressif. Avant d'accéder aux raccordements électriques, il faut utiliser un dispositif d'isolation électrique approuvé pour déconnecter le démarreur progressif de la tension d'entrée.

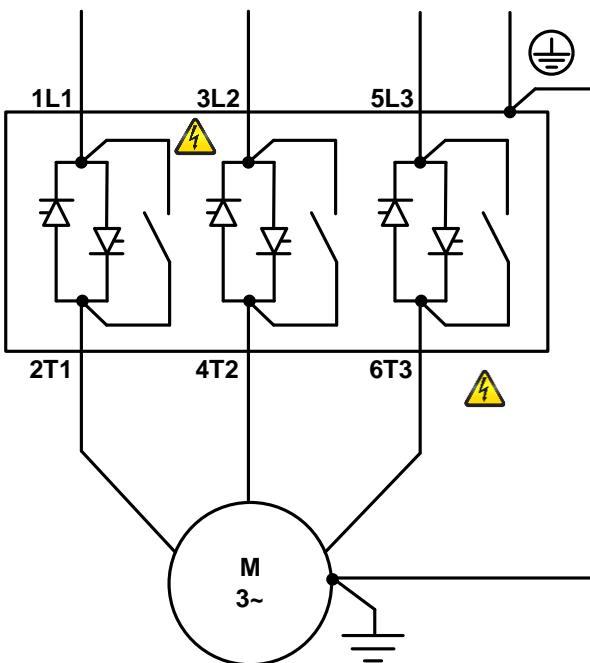


Model Number Description

It is essential to check the VMX-Synergy Plus™ nameplate and make sure that the soft starter is properly sized for your AC motor.

VMX-SGY-A- XXXX - XX

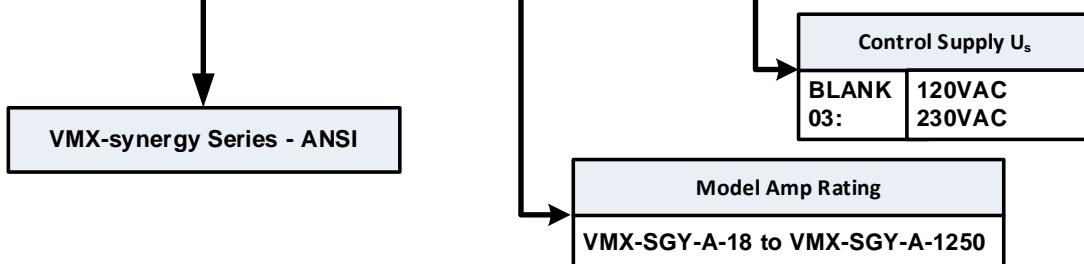

Key Features

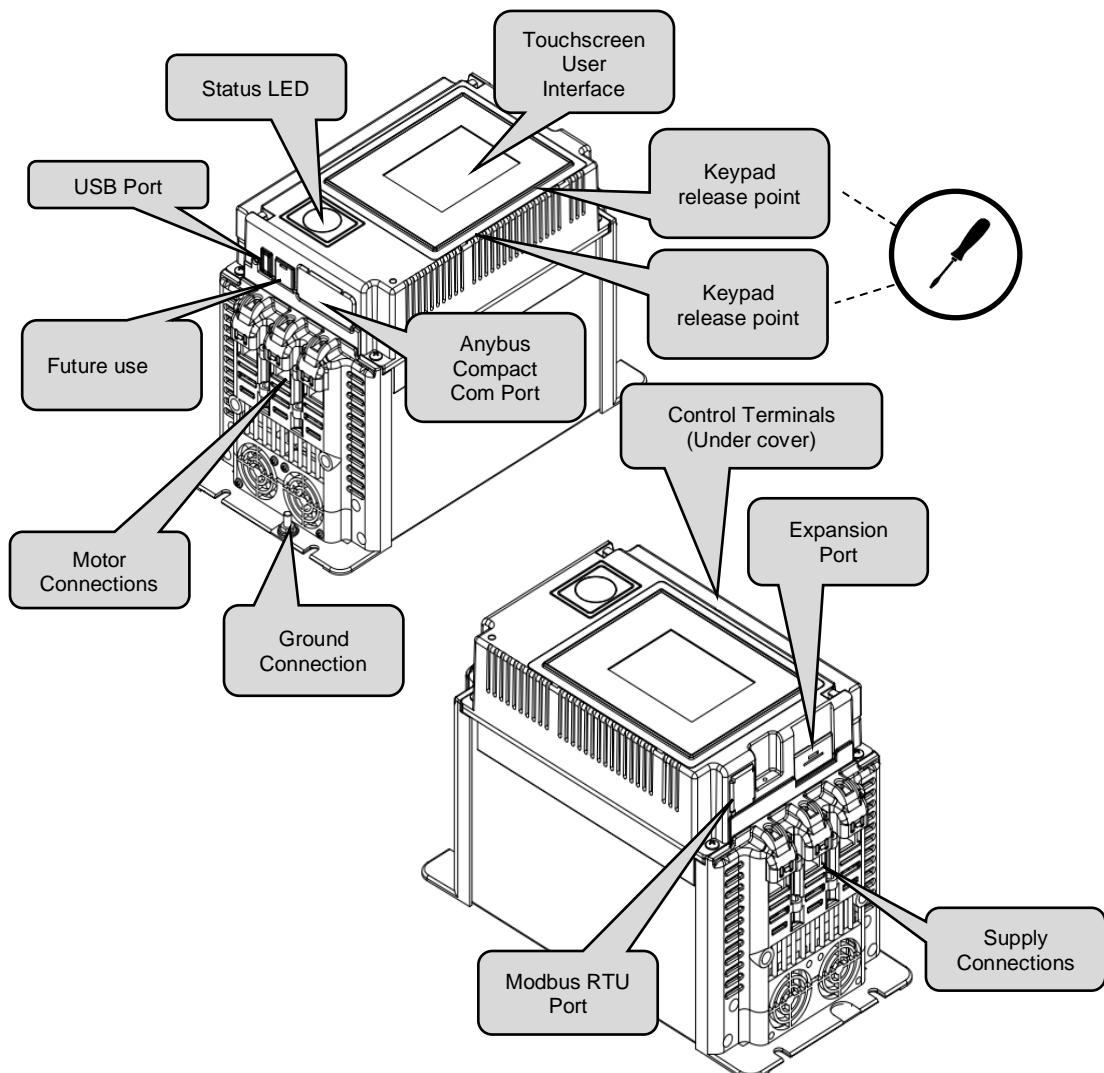

Environment - Installation


| Model (VMX-SGY-A-) | 18-48 | 62 | 78 | 92 | 112 | 150 | 160 | 210 | 275 | | | | | | | | | | | | | |
|--|--|------------|------------|------------|------------|------------|-------------|-------------|------------|--|--|--|--|--|--|--|--|--|--|--|--|--|
| Frame Size | 1 | 2 | | | | 3 | | 4 | | | | | | | | | | | | | | |
| Control Power (VA) | 48 | 60 | | | 100 | | 300 | 300 | | | | | | | | | | | | | | |
| Weight lb [kg] | 8.8 [4.0] | 23 [10] | | | 33 [15] | | 130 [59] | 140 [64] | | | | | | | | | | | | | | |
| Model (VMX-SGY-A-) | 361 | 450 | 550 | 600 | 862 | 900 | 1006 | 1250 | | | | | | | | | | | | | | |
| Frame Size | 4 | | | | 5 | | 6 | | | | | | | | | | | | | | | |
| Control Power (VA) | 350 | | | | 500 | | 750 | | | | | | | | | | | | | | | |
| Weight [lb] kg | 145 [66] | 165 [75] | | 325 [147] | | 400 [181] | | | | | | | | | | | | | | | | |
| Model (VMX-SGY-A-) | 18 to 1250 | | | | | | | | | | | | | | | | | | | | | |
| Ambient Operating Temp. | -4°F [-20°C] to 104°F [40°C]; not above 122°F (50°C) | | | | | | | | | | | | | | | | | | | | | |
| Transportation and Storage Temperature | [-13°F to 158°F (-25°C to 70°C) continuous | | | | | | | | | | | | | | | | | | | | | |
| Humidity | max 85% non-condensing, not exceeding 50% @ 40°C [104°F] | | | | | | | | | | | | | | | | | | | | | |
| Maximum Altitude | 3281ft [1,000m] above 1000m derate by 1% of VMX-Synergy Plus™ current rating per 328ft (100m) to a maximum altitude of 6562ft (2,000m) | | | | | | | | | | | | | | | | | | | | | |
| Environmental Rating | Main Circuit: Open Chassis (Optional finger guards available for power terminals on VMX-SGY-A-18 to 48); Control Circuit: NEMA 1; No corrosive gases permitted | | | | | | | | | | | | | | | | | | | | | |

| Model (VMX-SGY-A-) | Recommended minimum CPT Rating (VA) |
|---------------------------|--|
| VMX-SGY-A-18 to 48 | 100 |
| VMX-SGY-A-62 to 112 | 250 |
| VMX-SGY-A-150 to 160 | 500 |
| VMX-SGY-A-210 to 276 | 500 |
| VMX-SGY-A-361 to 600 | 750 |
| VMX-SGY-A-862 to 900 | 1000 |
| VMX-SGY-A-1006 to 1250 | 1500 |

Environment - Installation


Dimensions

VMX-SGY-A-18 to VMX-SGY-A-48

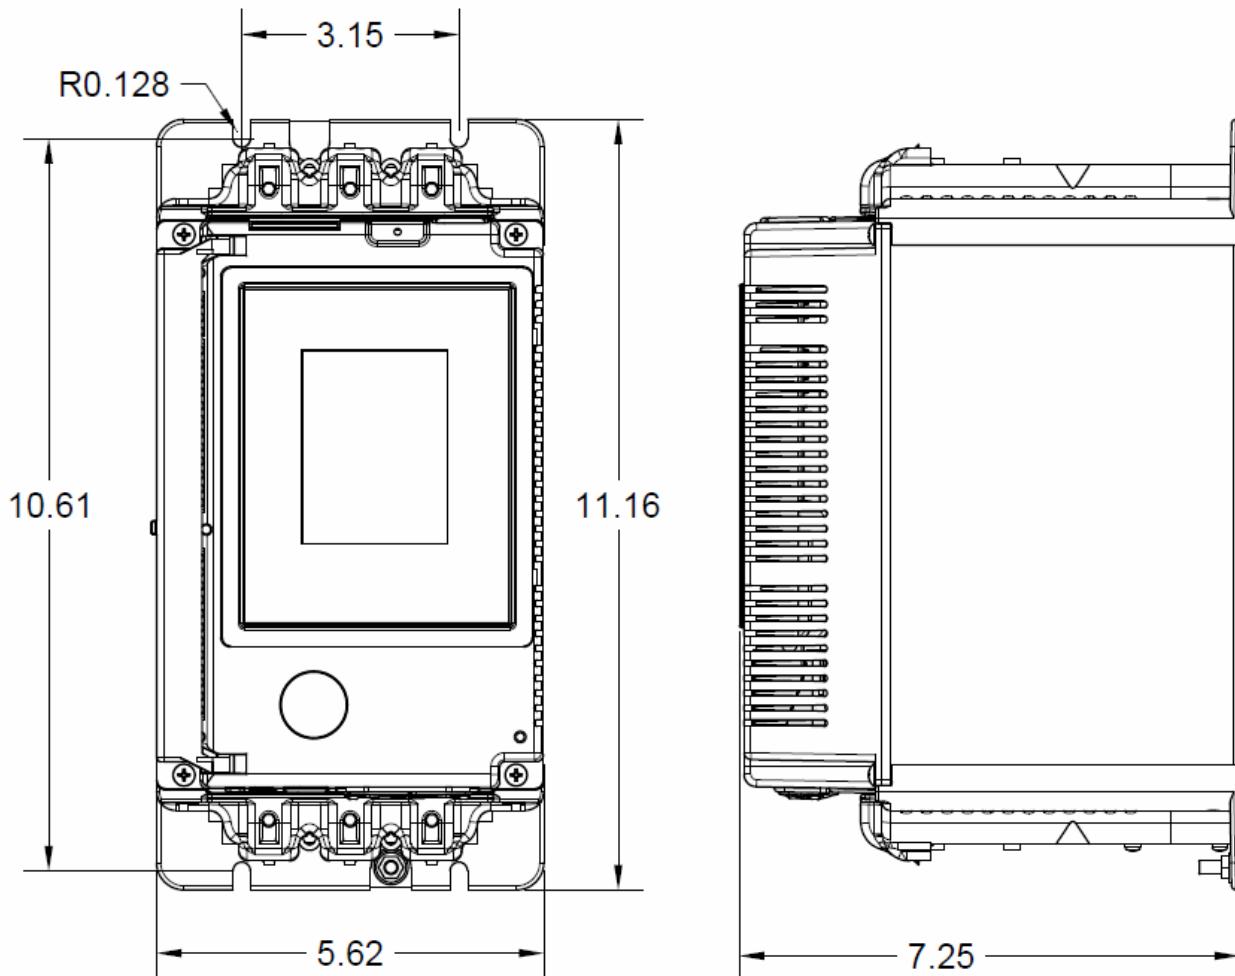


Environment - Installation

VMX-SGY-A-62 to VMX-SGY-A-112

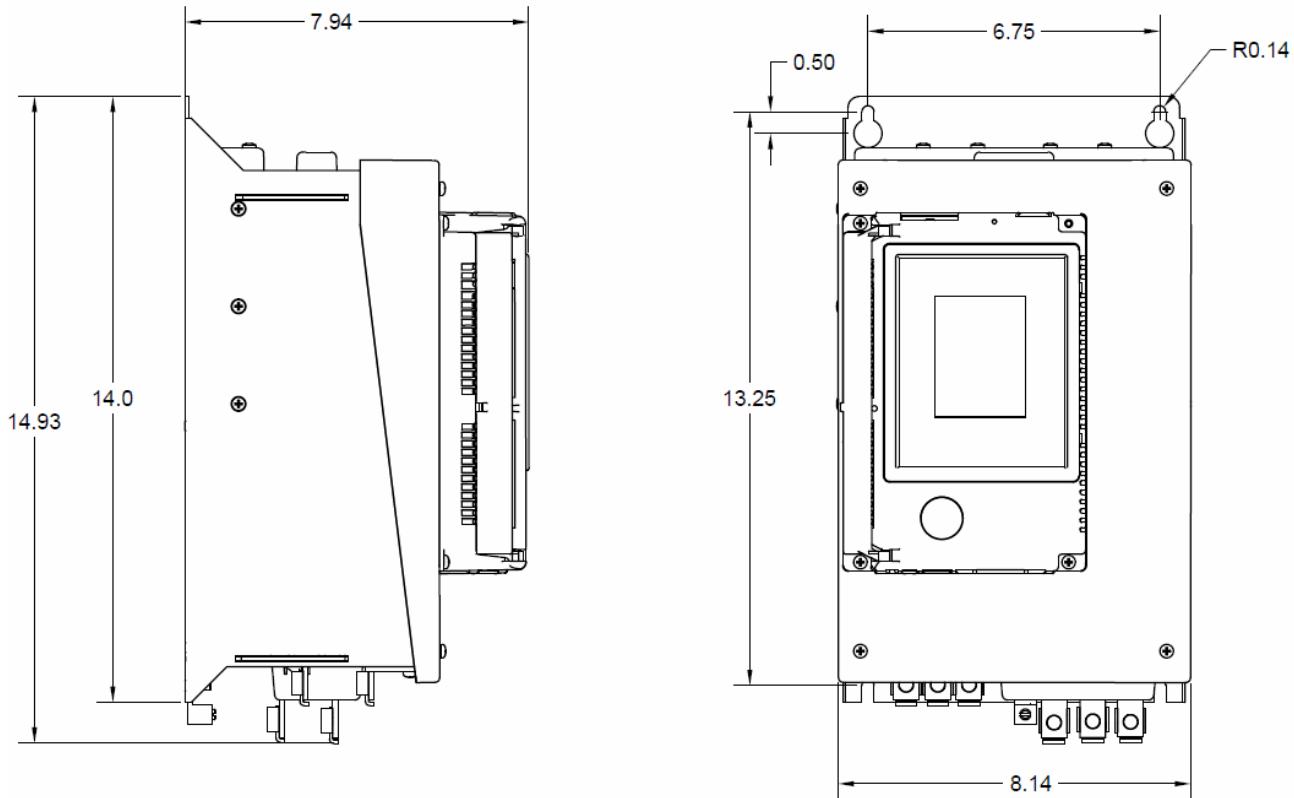


Environment - Installation

VMX-SGY-A-150 to VMX-SGY-A-160

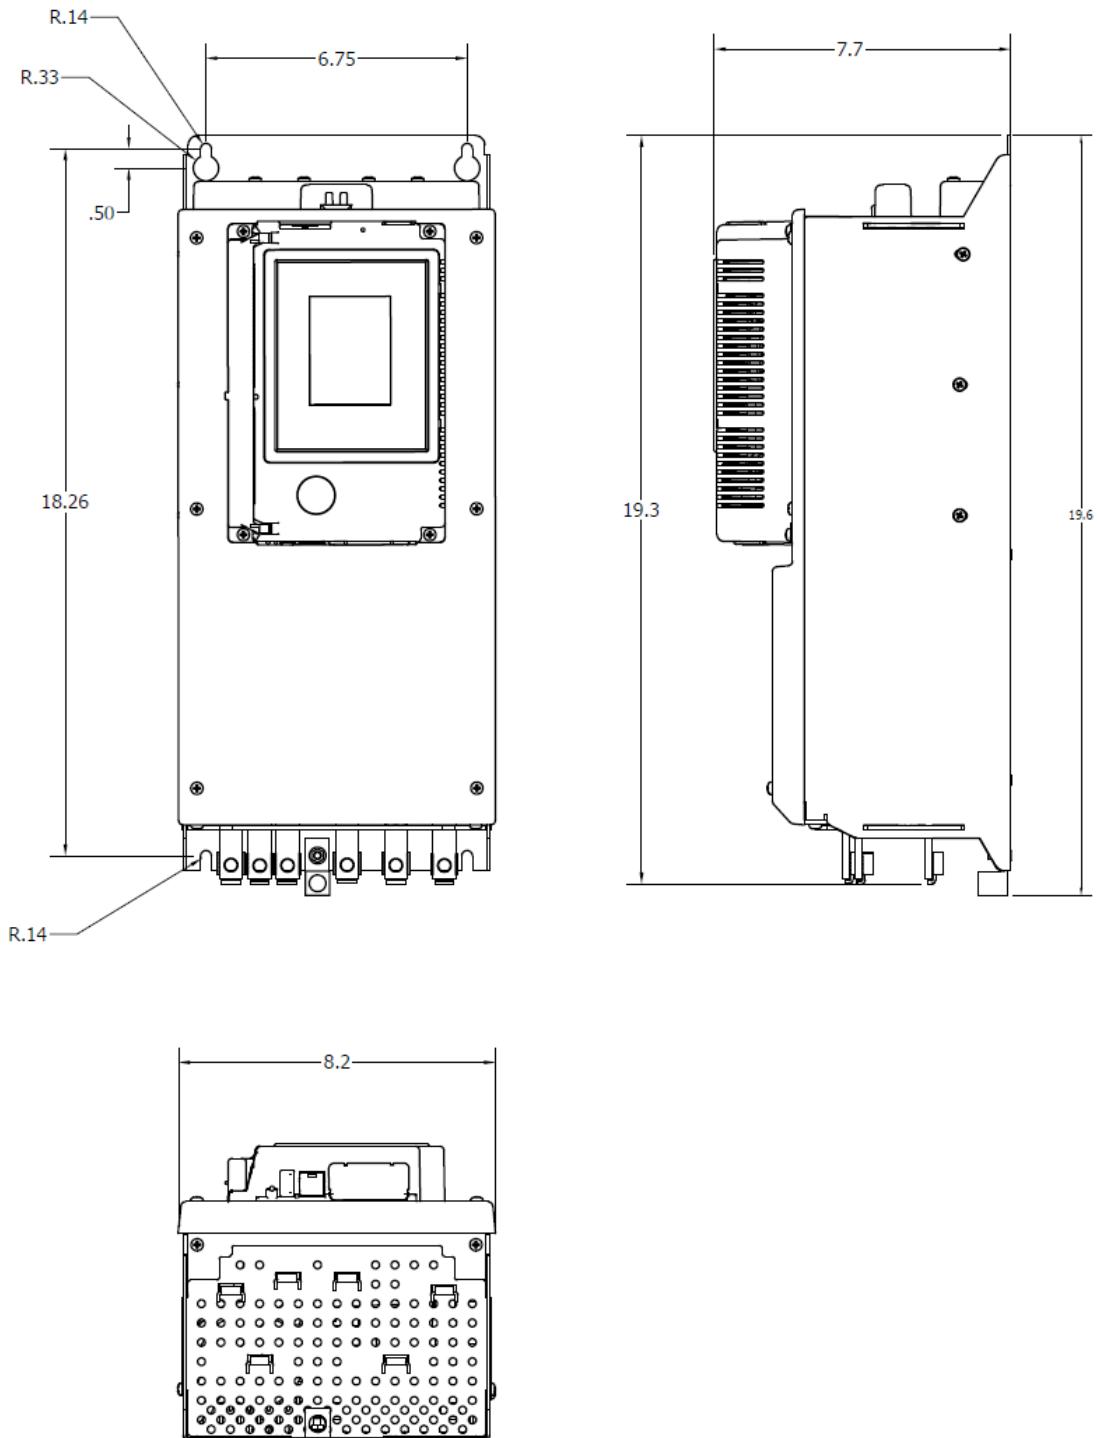



Environment - Installation

VMX-SGY-A-210 to VMX-SGY-A-600

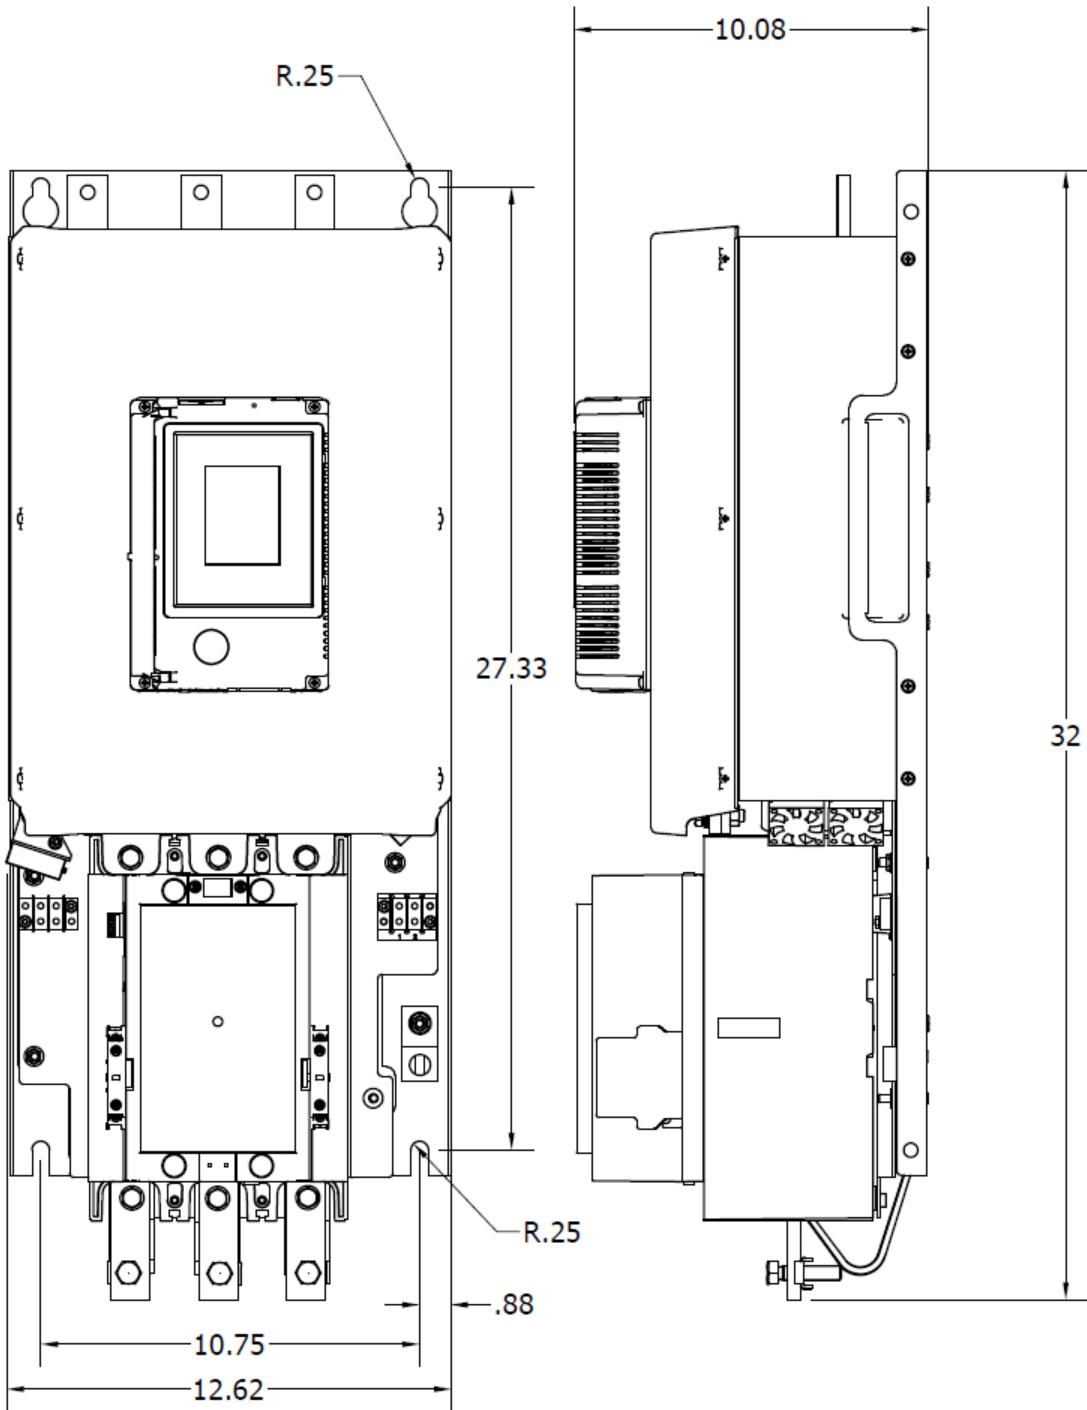



Environment - Installation

VMX-SGY-A-862 to VMX-SGY-A-900

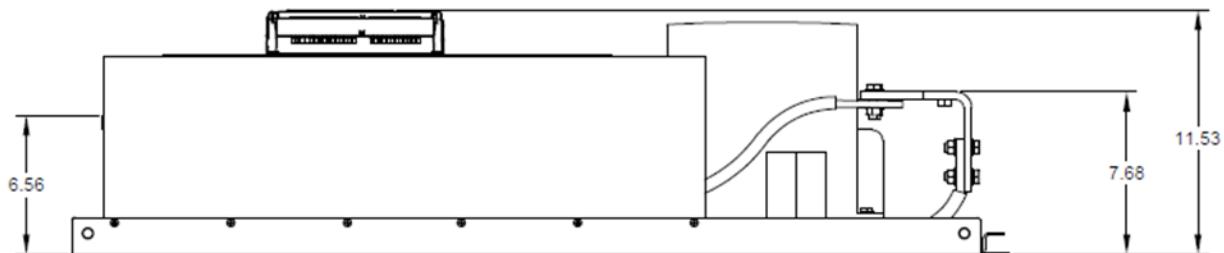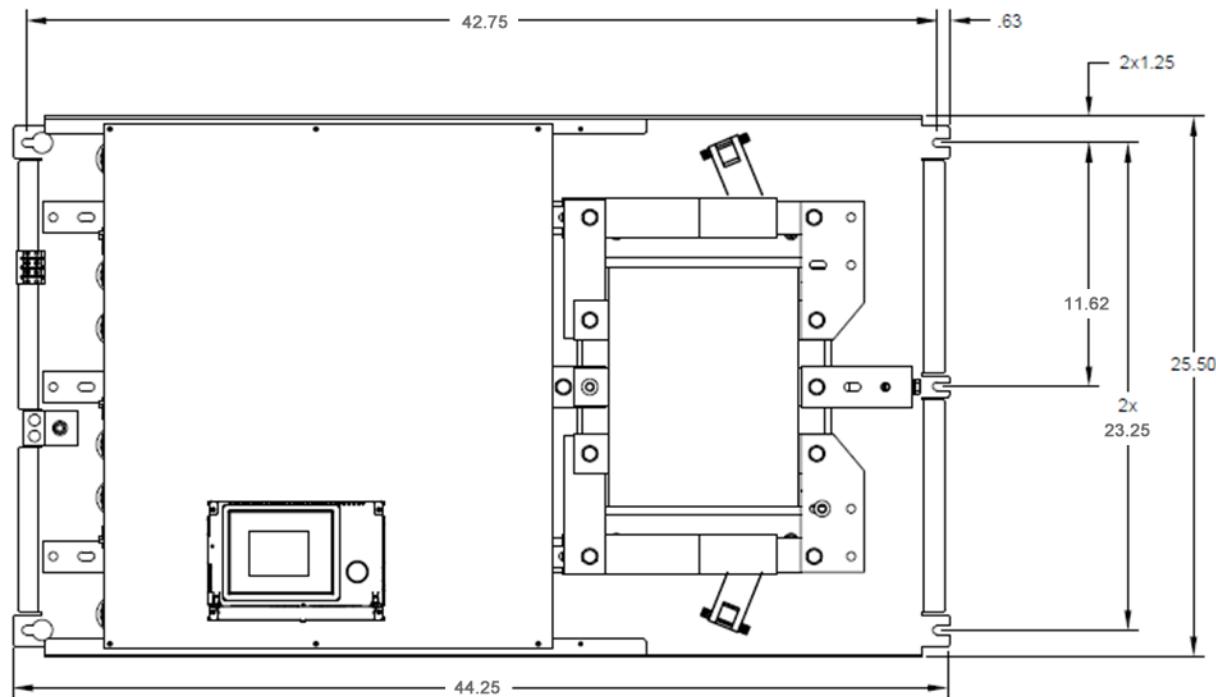

Environment - Installation

VMX-SGY-A-1006 to VMX-SGY-A-1250

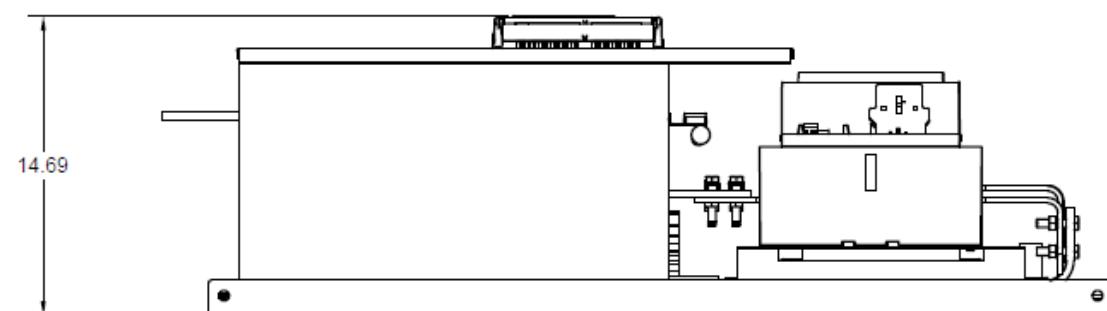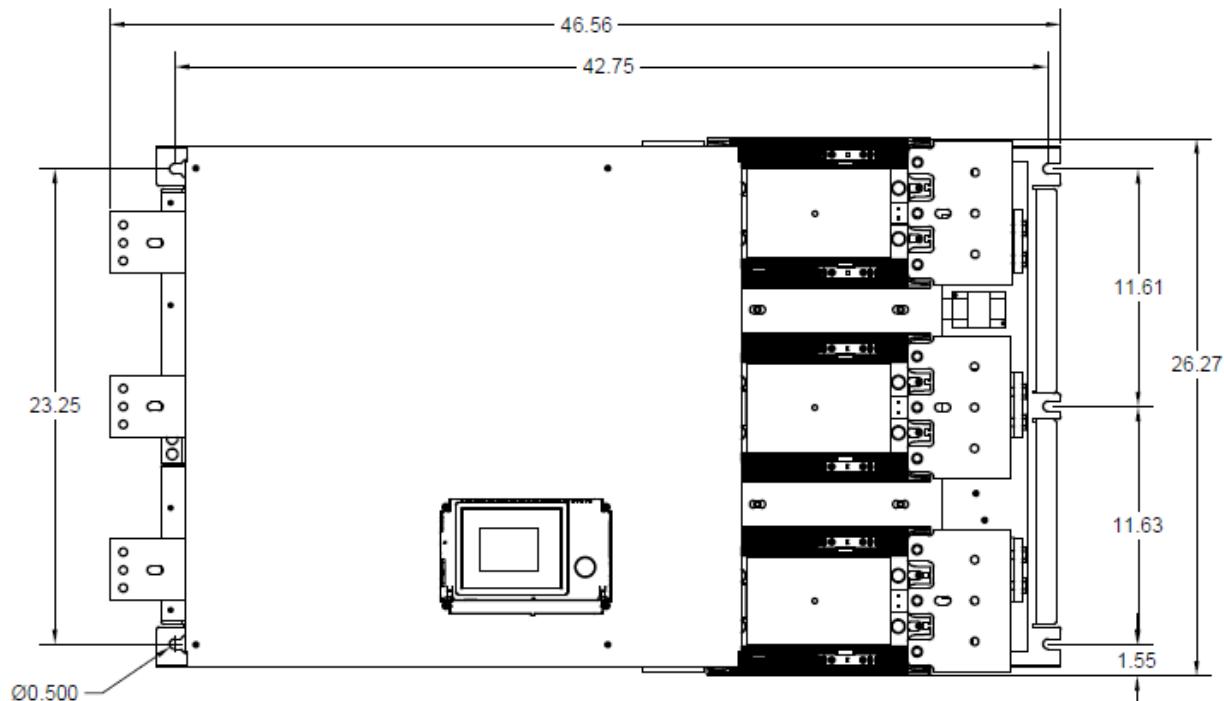

Environment - Installation



Enclosure Ventilation

When installing a VMX-Synergy Plus™ into an enclosure, ventilation must be provided if the heat output of the unit is greater than the cabinet will dissipate. Use the following formula to determine the fan requirement. An allowance has been incorporated into the formula so that the figure for Q is the air delivery in the fan supplier's data.

Heat dissipated can be approximated with the formulas: -

Starting

Watts (VMX-Synergy Plus™) = start current(A) x start time(s) x number of starts per hour/1200

iERs Disabled

Watts (VMX-Synergy Plus™) = (VMX-Synergy Plus™ current rating) x 0.6

iERs Enabled

The maximum power dissipation occurs when energy saving and the iERS is turned on

Watts (VMX-Synergy Plus™) = (VMX-Synergy Plus™ current rating) x 1.5

$$Q = \frac{4 \times Wt}{(T_{max} - T_{amb})}$$

Q = volume of air (cubic meters per hour-m³/h)

Wt = Heat produced by the unit and all other heat sources within the enclosure (Watts)

T_{max} = Maximum permissible temperature within the enclosure (50°C for a fully rated VMX-Synergy Plus™)

T_{amb} = Temperature of the air entering the enclosure (°C)


If you prefer to work in CFM, substitute °F for °C. Q is now in CFM

Conductor Size & Torque Requirements

| Model Number | Current Range Min.- Max. | Suggested Wire Size AWG | Tightening Torque in.-lbs. | Screw / Bolt Size | Tightening Torque Nm | Recommended Terminal (or equivalent) |
|--------------------|--------------------------|-------------------------|----------------------------|---|-----------------------|--------------------------------------|
| VMX-SGY-A-18 to 48 | 18 - 48 | 6 | 80 | * | 9 | * |
| VMX-SGY-A-62 | 36 - 62 | 4 | | | | |
| VMX-SGY-A-78 | 39 - 78 | 3 | | | | |
| VMX-SGY-A-92 | 46 - 92 | 2 | | | | |
| VMX-SGY-A-112 | 56 - 112 | 1/0 | | | | |
| VMX-SGY-A-150 | 75 - 150 | 3/0 | | | | |
| VMX-SGY-A-160 | 80 - 160 | 3/0 | | | | |
| VMX-SGY-A-210 | 105 - 210 | 300 kCMIL | | | | |
| VMX-SGY-A-275 | 138 - 275 | 500 kCMIL | | | | |
| VMX-SGY-A-361 | 180 - 361 | 2 x 4/0 | | | | |
| VMX-SGY-A-450 | 225 - 450 | 2 x 300 kCMIL | | | | |
| VMX-SGY-A-550 | 275 - 550 | 2 x 500 kCMIL | | | | |
| VMX-SGY-A-600 | 300 - 600 | 2 x 500 kCMIL | | | | |
| VMX-SGY-A-862 | 431 - 862 | 3 x 500 kCMIL | | | | |
| VMX-SGY-A-900 | 450 - 900 | 3 x 500 kCMIL | | | | |
| VMX-SGY-A-1006 | 503 - 1006 | 4 x 400 kCMIL | | | | |
| VMX-SGY-A-1250 | 625 - 1250 | 4 x 600 kCMIL | | | | |
| | | | | 1 x M8 (included) | 15 | ILSCO TA-250 |
| | | | | 1 x M10 (included) | 22 | ILSCO TA-500 2x (Top & Bottom) |
| | | | | 1 x 0.38" hole (M10) for User supplied lugs | Hardware not supplied | ILSCO PB3-600 |
| | | | | | Hardware not supplied | ILSCO PB4-600 |


* Saddle Clamp Terminal 12-2/0 AWG

Terminal Designations and Wiring Connection

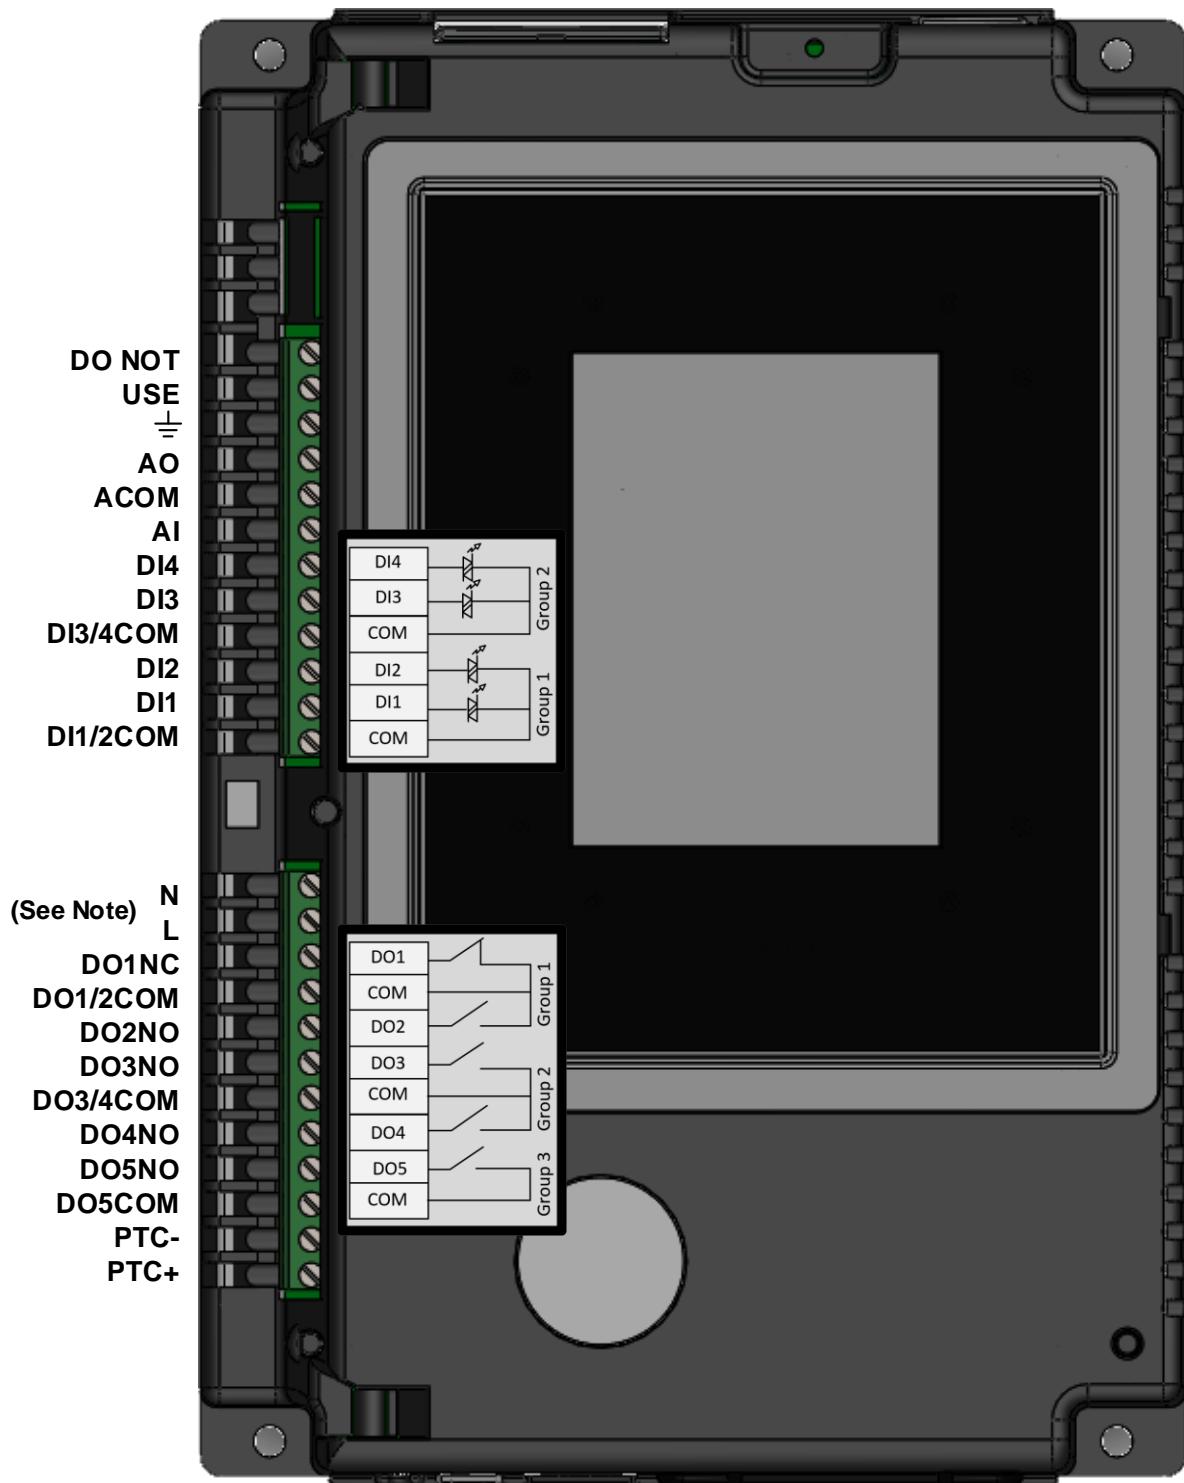

NOTE: AC Input terminals L & N on starter module only available on models VMX-SGY-A-18 to VMX-SGY-A-160. For all other models the control power input is located on the chassis frame mounted terminal block (see next page).

Control power input location for VMX-SGY-A-210 and up

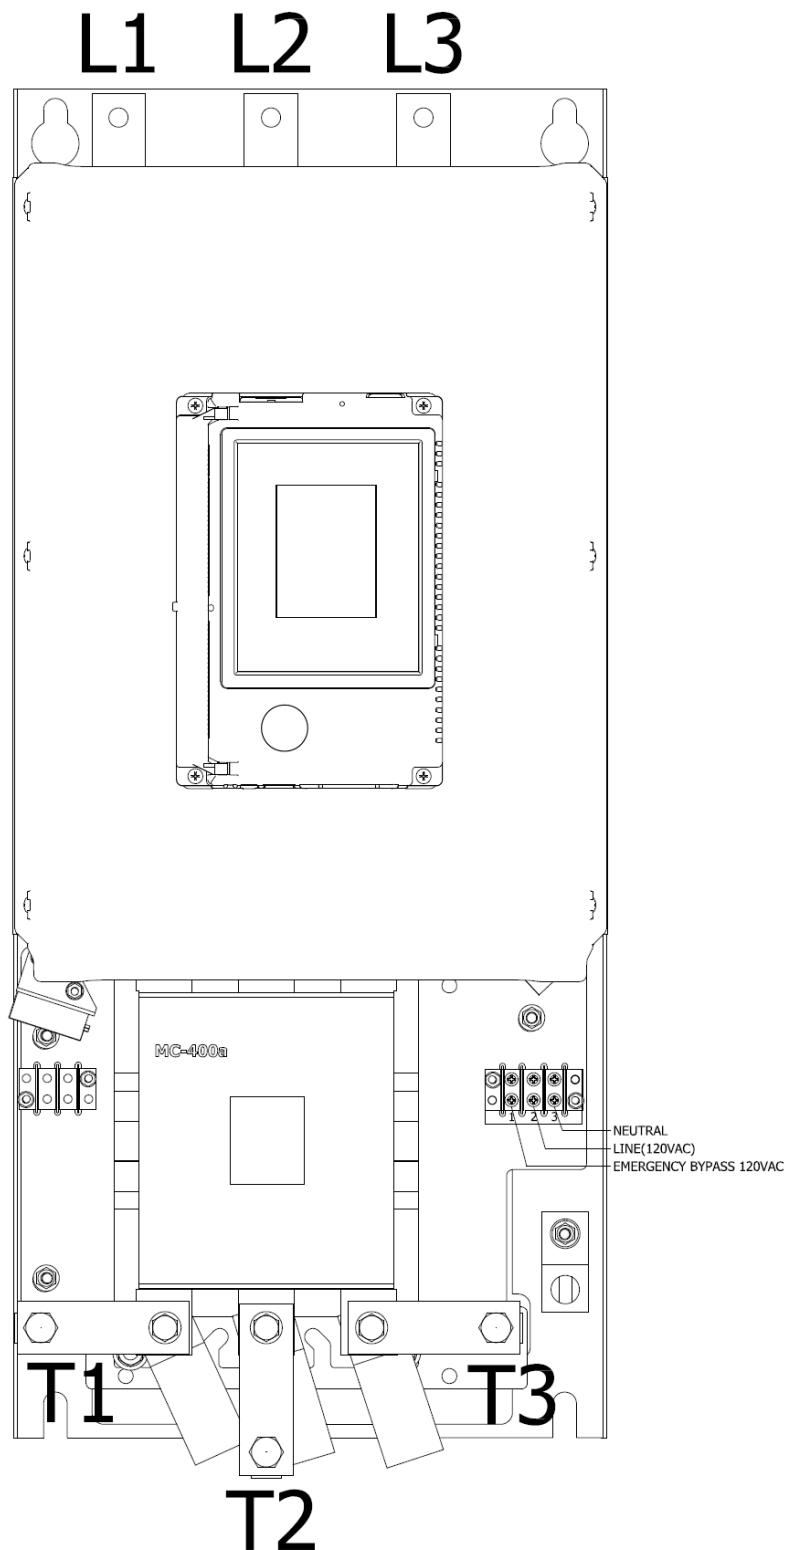

Supply 120 VAC control power to terminal 2 and 3 of the 120 VAC control power terminal block shown above. To close the contactor for Emergency purposes put a jumper between terminal 1 to 2 or supply 120 VAC to terminal 1 and 3."

Terminal Description



| Terminal Name | Description | Programmable | | Rating | Notes |
|-----------------|------------------------------|------------------|--------------|----------------|-------|
| AO | Analog Output | 0-10V or 4-20mA | | | |
| ACOM | Analog Common | | | | |
| AI | Analog Input | 0-10V or 4-20mA | | | |
| DI4 | Digital Input Group 2 | 240VAC or 120VAC | | | #1 |
| DI3 | Digital Input Group 2 | 240VAC or 120VAC | | | #1 |
| DI3/4COM | Digital Input Group 2 Common | | | | #1 |
| DI2 | Digital Input Group 1 | 240VAC or 120VAC | None | | #1 |
| DI1 | Digital Input Group 1 | 240VAC or 120VAC | Start / Stop | | #1 |
| DI1/2COM | Digital Input Group 1 Common | | | | #1 |
| <hr/> | | | | | |
| N | Neutral - Control supply | | | 120VAC-240VAC | #2 |
| L | Line - Control supply | | | | #2 |
| DO1NC | Group 1 relay N/C | Yes | Fault | 240VAC 1A AC15 | |
| DO1/2COM | Group 1 relay common | | | | |
| DO2NO | Group 1 relay N/O | Yes | Fault | 240VAC 1A AC15 | |
| DO3NO | Group 2 relay N/O | Yes | Running | 240VAC 1A AC15 | |
| DO3/4COM | Group 2 relay common | | | | |
| DO4NO | Group 2 relay N/O | Yes | End of Start | 240VAC 1A AC15 | |
| DO5NO | Group 3 relay N/O | Yes | Running | 240VAC 3A AC15 | |
| DO5COM | Group 3 relay common | | | | |
| PTC- | PTC Temperature sensor input | | | | |
| PTC+ | PTC Temperature sensor input | | | | |

TABLE 1

Notes

| | |
|----|--|
| #1 | Digital input voltage must be set to the voltage applied to the digital input terminals DI1/2COM, DI3/4COM, DI1-DI4. Afin d'éviter d'endommager l'équipement, le réglage de l'entrée numérique programmé sur DI1/2COM, DI3/4COM, DI1-DI4 doit correspondre à la tension appliquée à ces bornes. |
| #2 | The control supply can be 120 to 240V applied to the N, L. The correct voltage is specified by model # at time of order. L'alimentation contrôle peut être 120 à 240 Vca, appliquée aux bornes N et L. Afin d'éviter d'endommager l'équipement, la tension appropriée selon les indications ne doit être appliquée qu'à une entrée d'alimentation. |

Wiring Connection

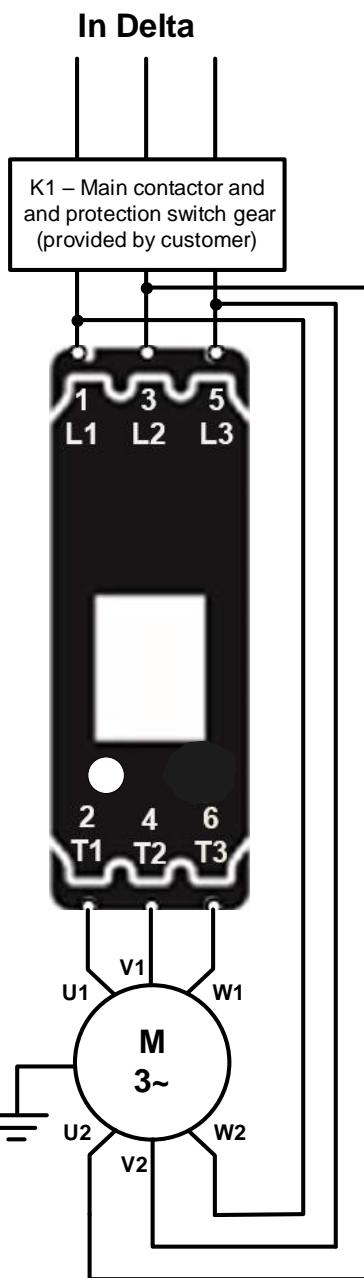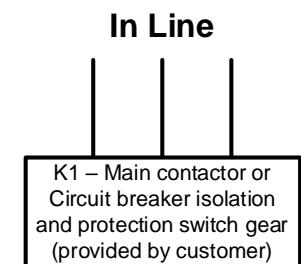

| Term1 | FWD | REV |
|-------|-----|-----|
| 2/T1 | U1 | U1 |
| 4/T2 | V1 | W1 |
| 6/T3 | W1 | V1 |
| 1/L1 | W2 | V2 |
| 3/L2 | U2 | U2 |
| 5/L3 | V2 | W2 |

| | | | |
|--|---|--|---|
| <p>! For suitable short circuit protection devices (SCPD's) see short Circuit Protection in the Technical Information/standards section of this guide.</p> <p>Pour un dispositif de protection approprié contre le court-circuit, voir la protection contre le court-circuit dans la section « Informations techniques/normes » du présent guide.</p> | <p>! For wire size and torque requirements see Technical Information/standards section of this guide.</p> <p>Pour les dimensions de câble et les besoins en couple, voir la section « Informations techniques/normes » du présent guide.</p> | <p>! In Delta For this configuration applying the equation.</p> $VMX-Synergy\ Plus\ Ie = ie\ (motor)\ / \sqrt{3}$ <p>Allows lower current rating VMX-Synergy Plus than the motor.</p> <p>The contactor K1 can also be connected inside the delta circuit.</p> <p>When connected in the delta K1 current rating = $ie\ (motor)\ / \sqrt{3}$</p> | <p>! En Delta Pour cette configuration, appliquer l'équation suivante:</p> $VMX-Synergy\ Plus\ Ie = ie\ (moteur)\ / \sqrt{3}$ <p>Cela permet le courant nominal inférieur de VMX-Synergy Plus par rapport au moteur.</p> |
|--|---|--|---|

Wiring Connection




The programmed digital input voltage settings match the voltage applied to these terminals to avoid risk of damage to the equipment.



The control supply can be 120 to 240Vac applied to the N, L terminals. Check model number to determine correct control supply voltage (240AC is optional) to avoid risk of damage to the equipment.


Three Wire Control

3 Wire Control Diagram 120VAC control supply and digital input programming.

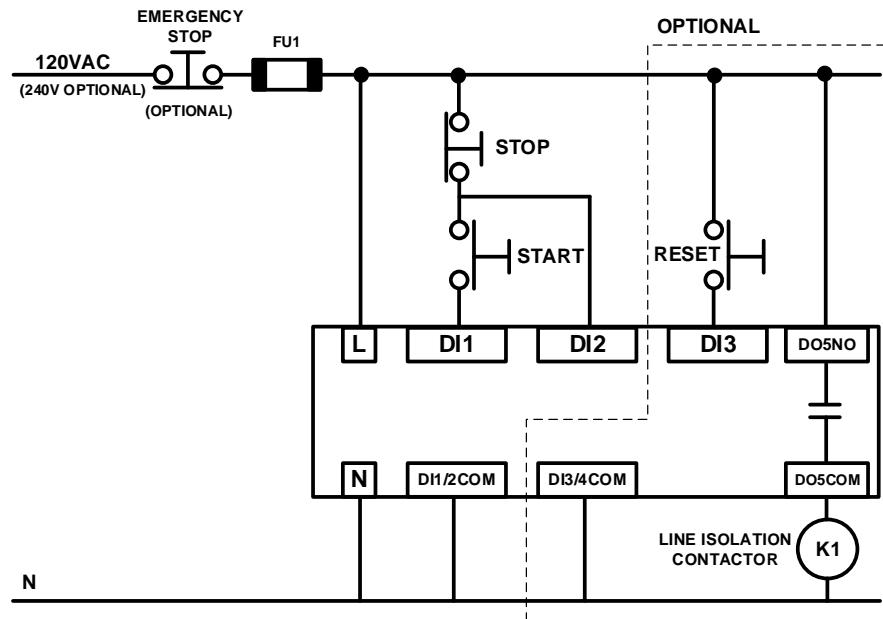


Two Wire Control

2 Wire Control Diagram 120VAC control supply and digital input programming.

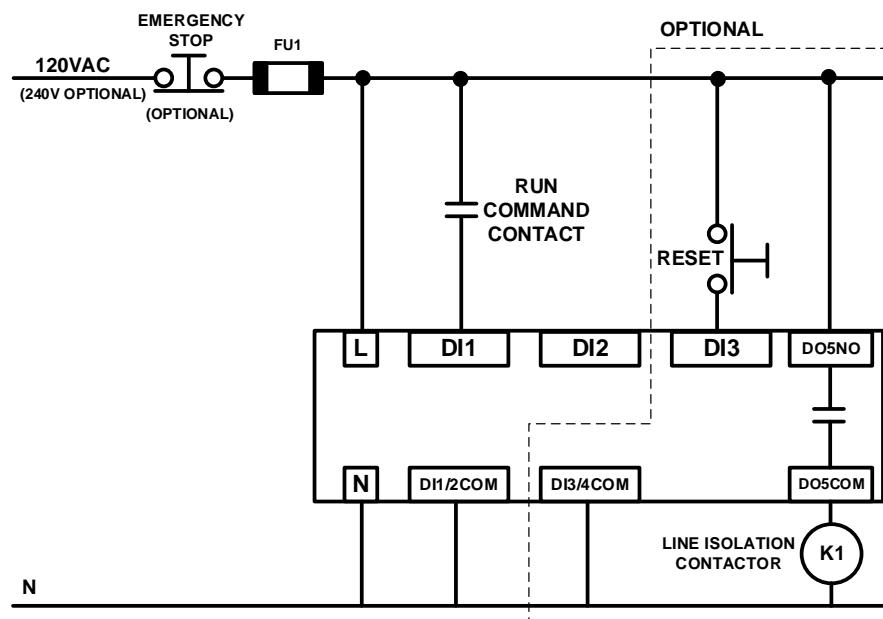


On Screen Menus


Initial Screen

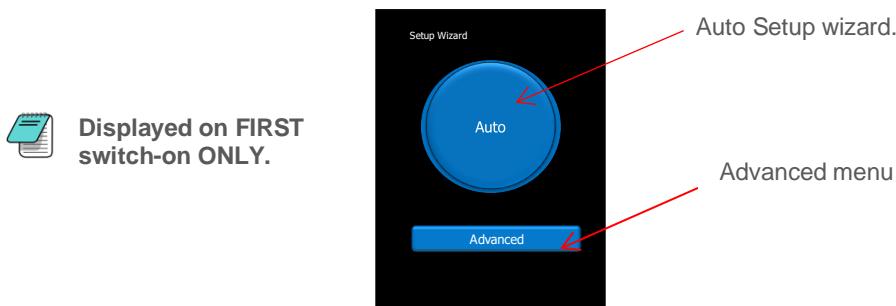


Status Screen

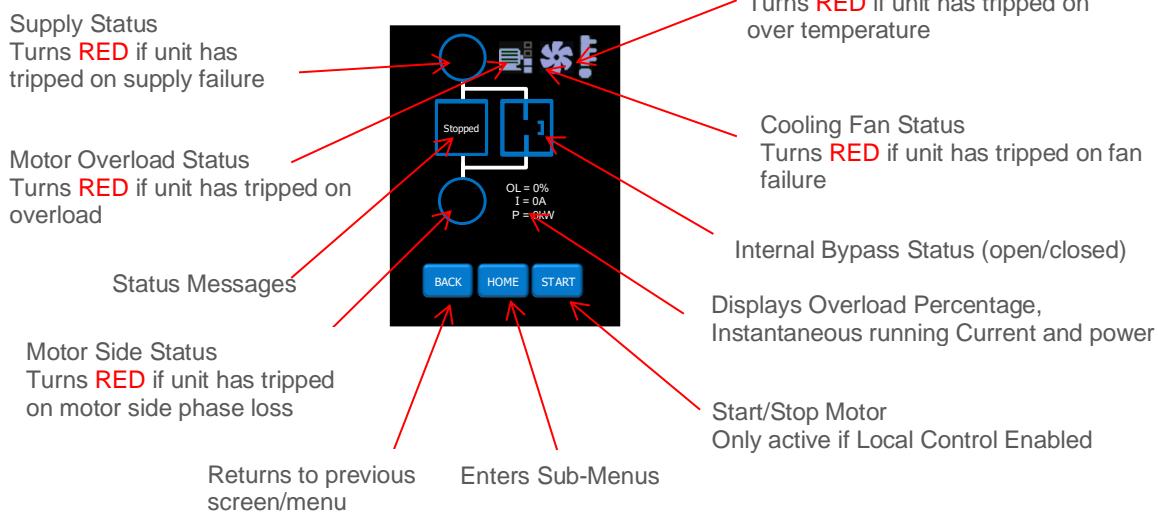

Home Screen

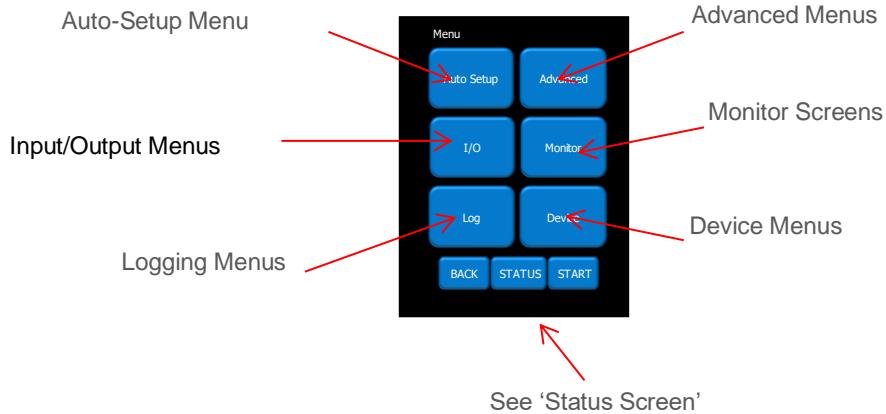


Auto Setup Example

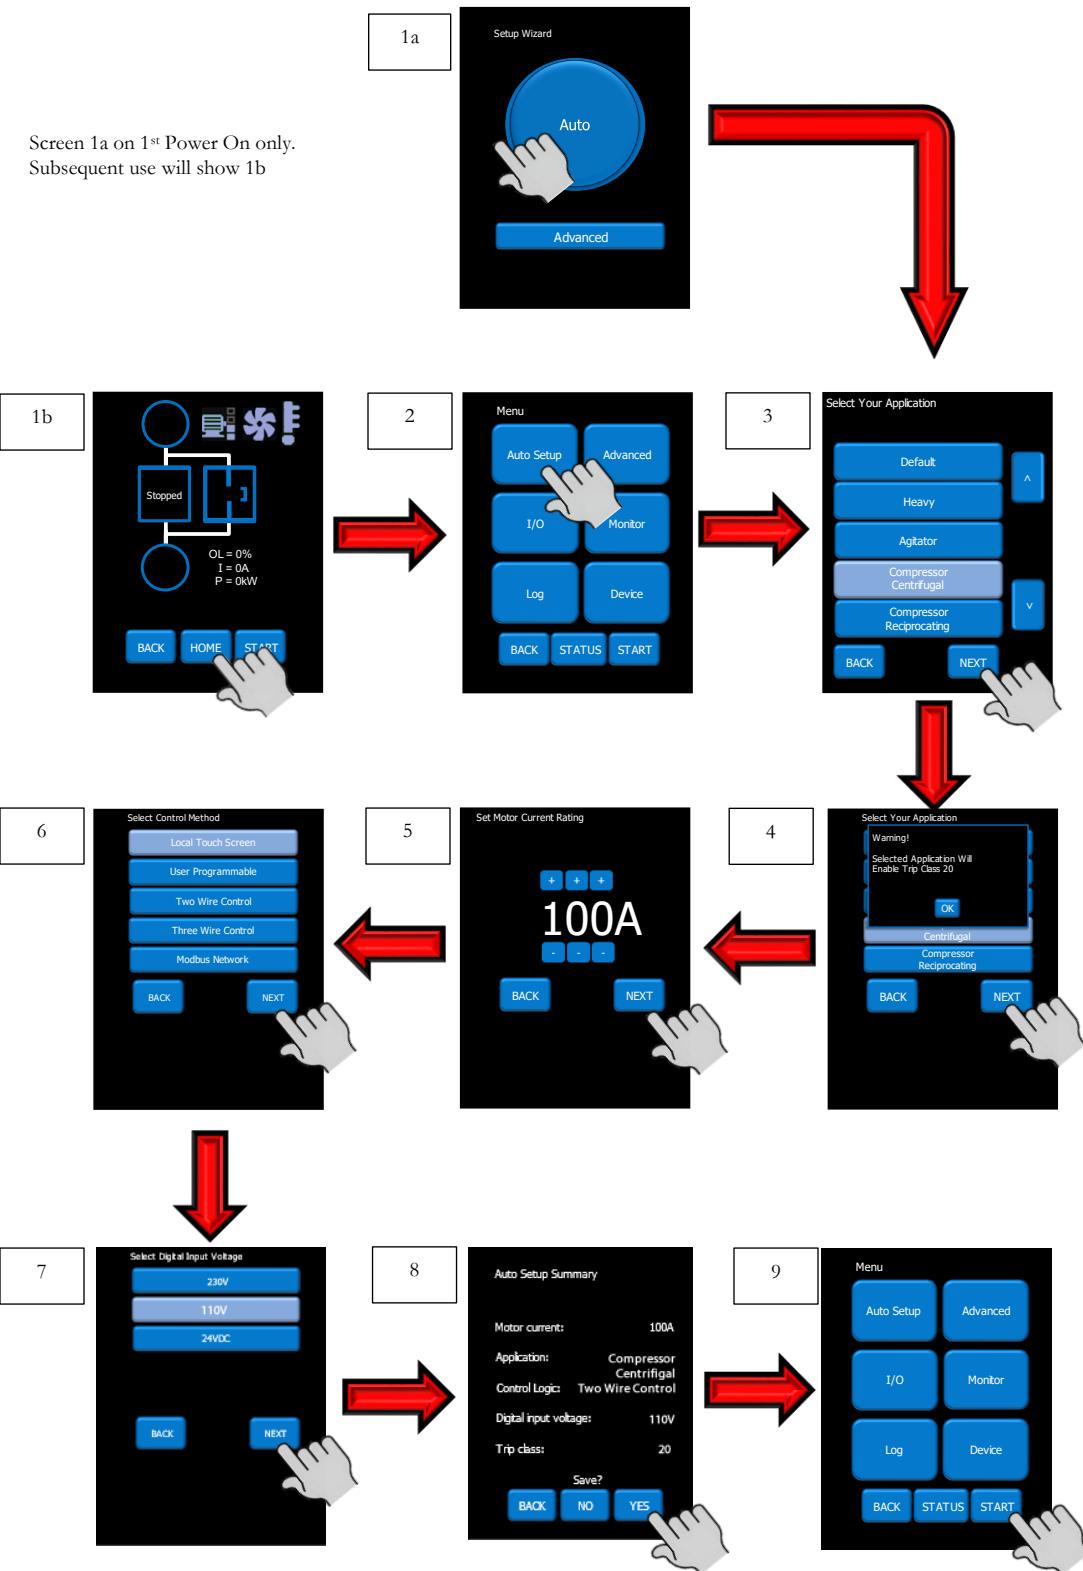


Programming Menu Structure


Advanced Menu

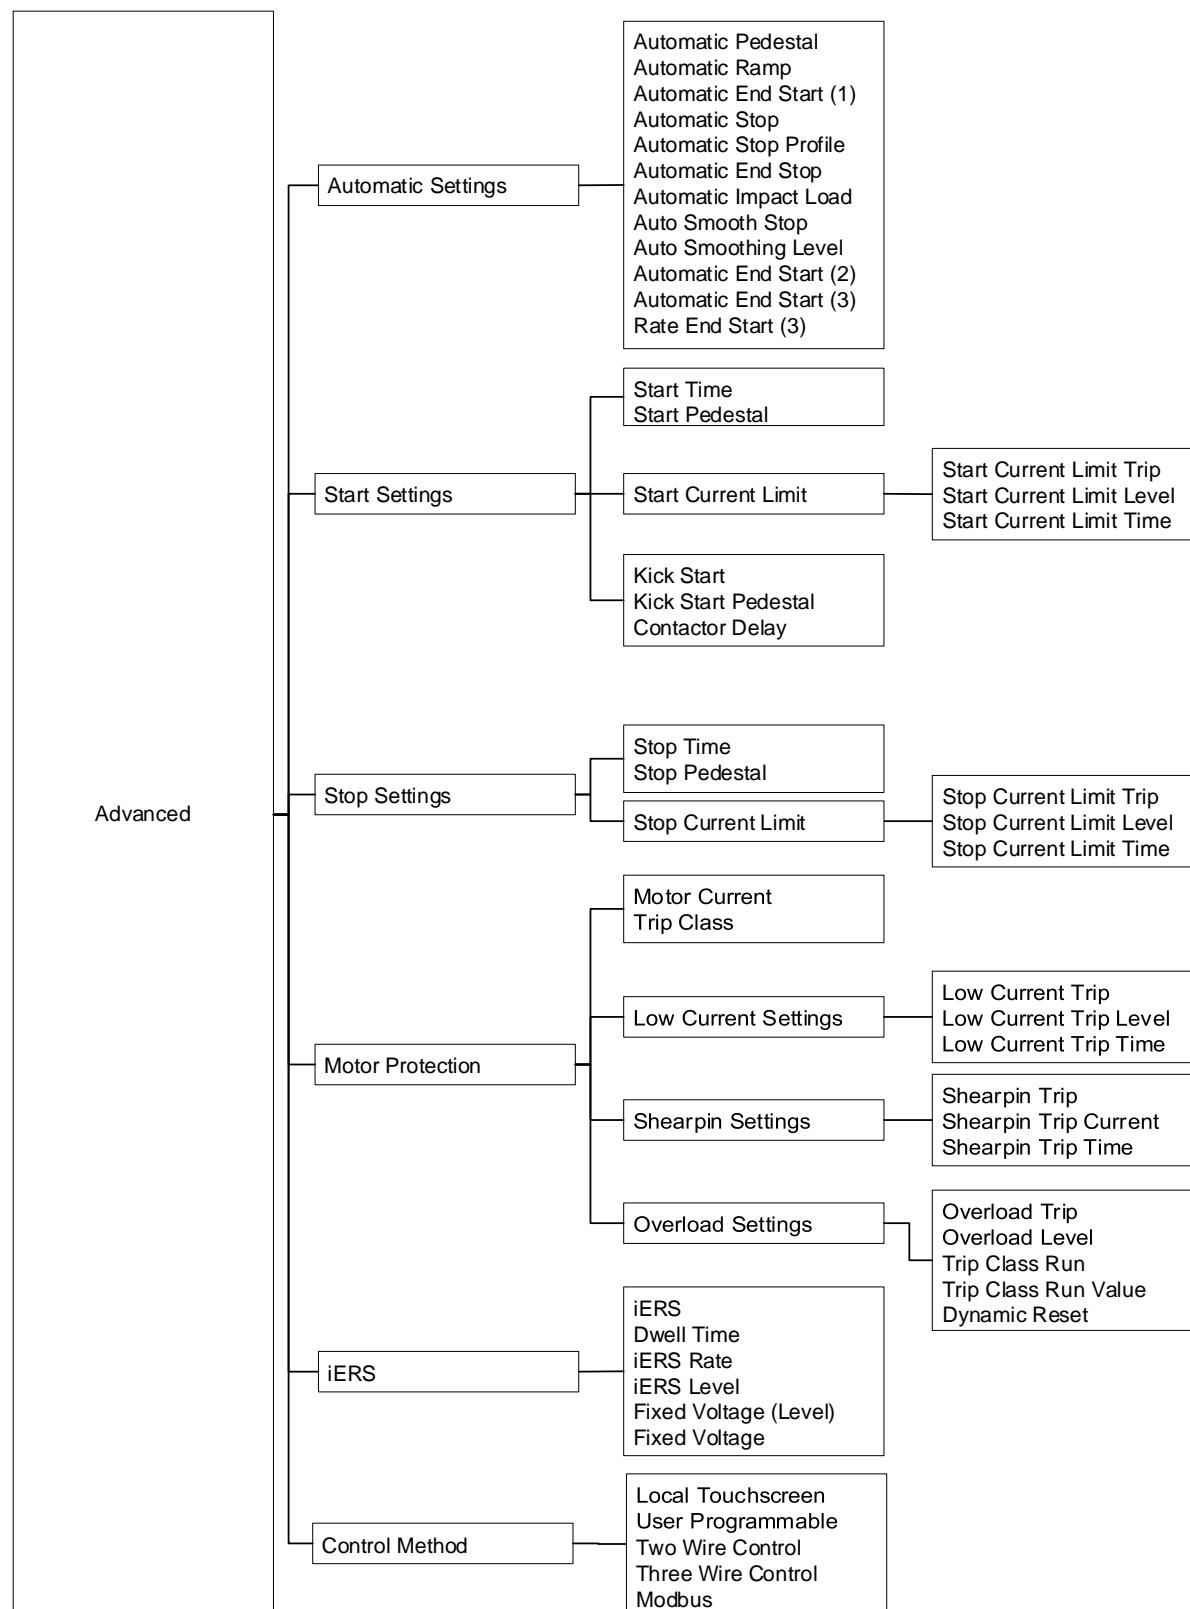


Advanced (continued)

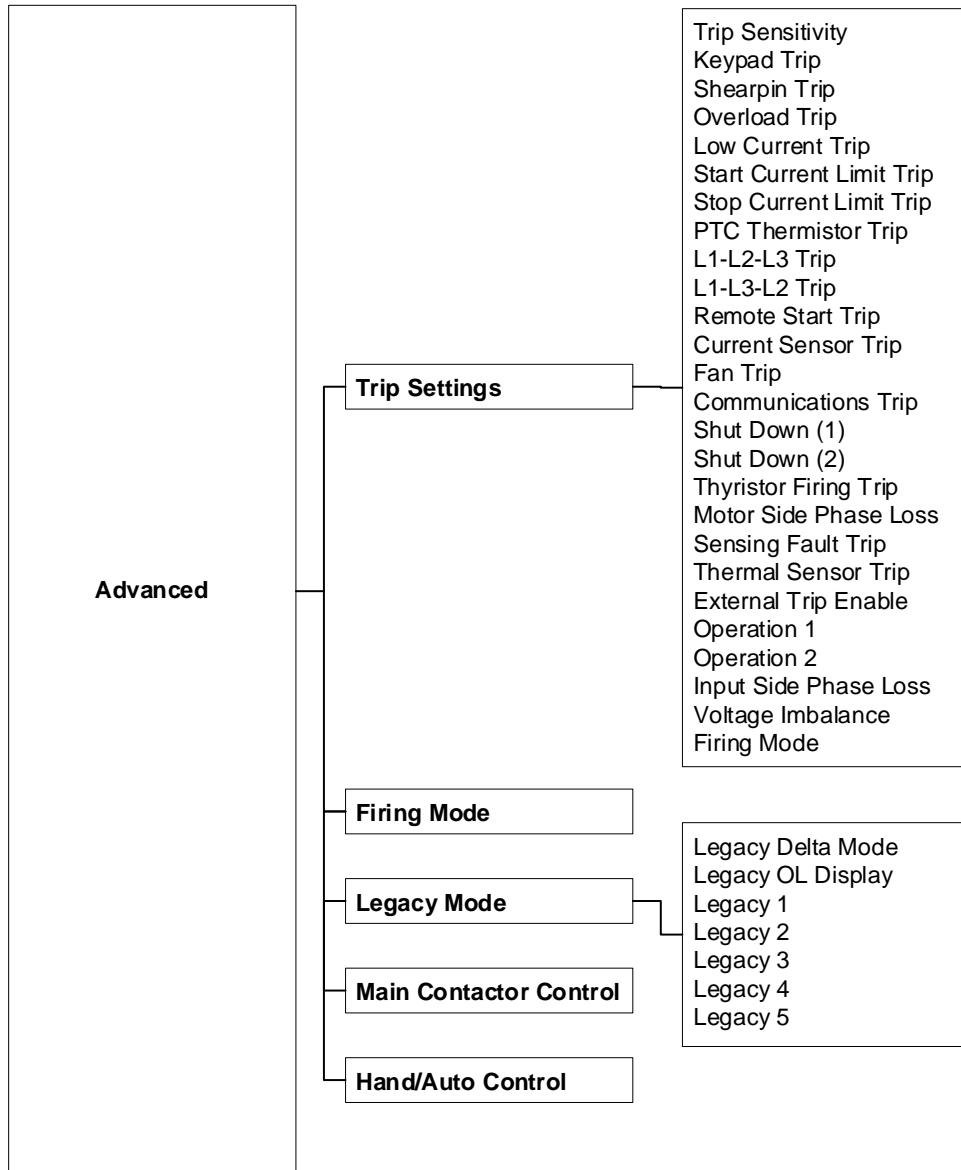

Advanced (continued)

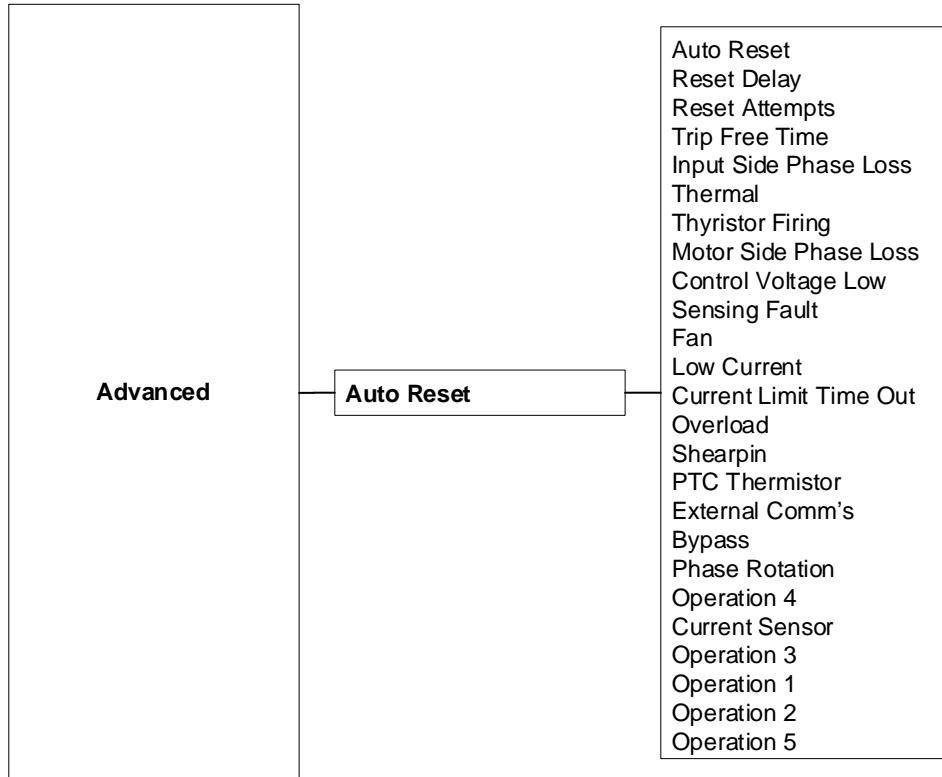


Input / Output Menu

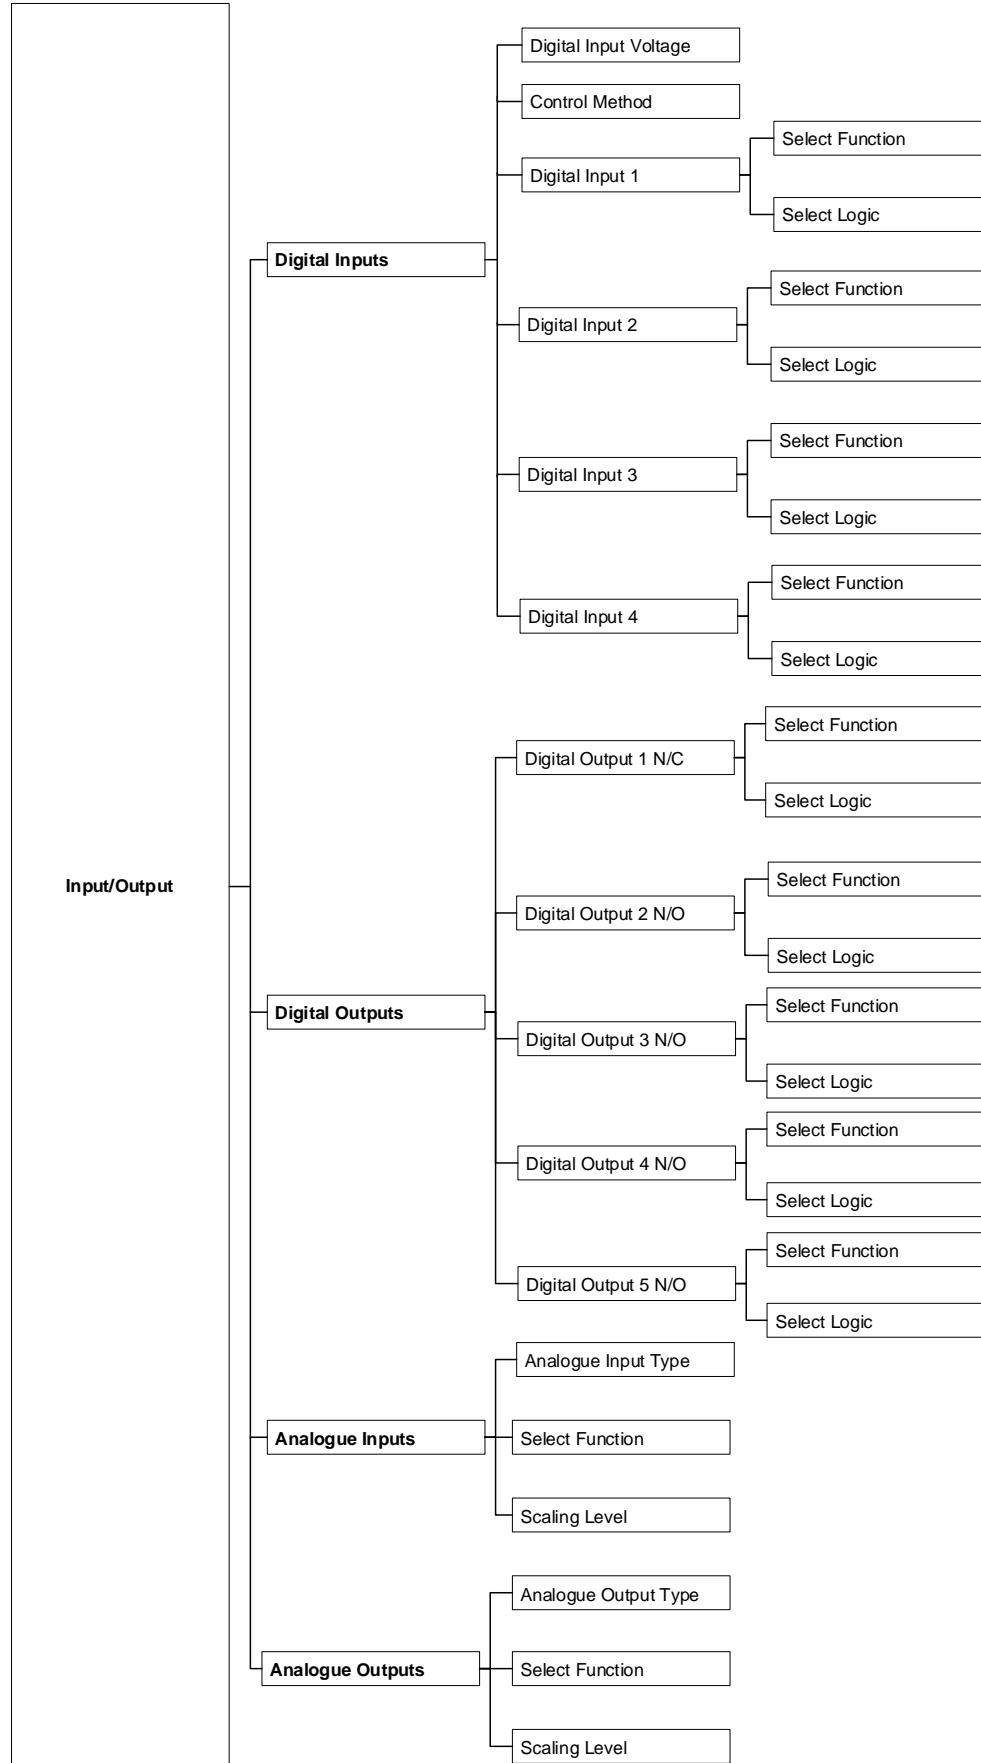

Monitor

| | |
|----------------|---|
| Monitor | Line Frequency Phase Rotation I1 I2 I3 Current Irms V1 V2 V3 Voltage Vrms HeatSink Temp True Power Factor True Power P Apparent Power S Reactive Power Q iERS Saving Level Delay Angle BackStop Delay Max Pres PF Degrees Ref PF Degrees Start Saving Level Last Peak Current Motor Thermistor Overload Auto Reset Pending Auto Reset Exceeded Reset Delay Reset Attempts Trip Free Time Trip Event |
|----------------|---|

Log Menu

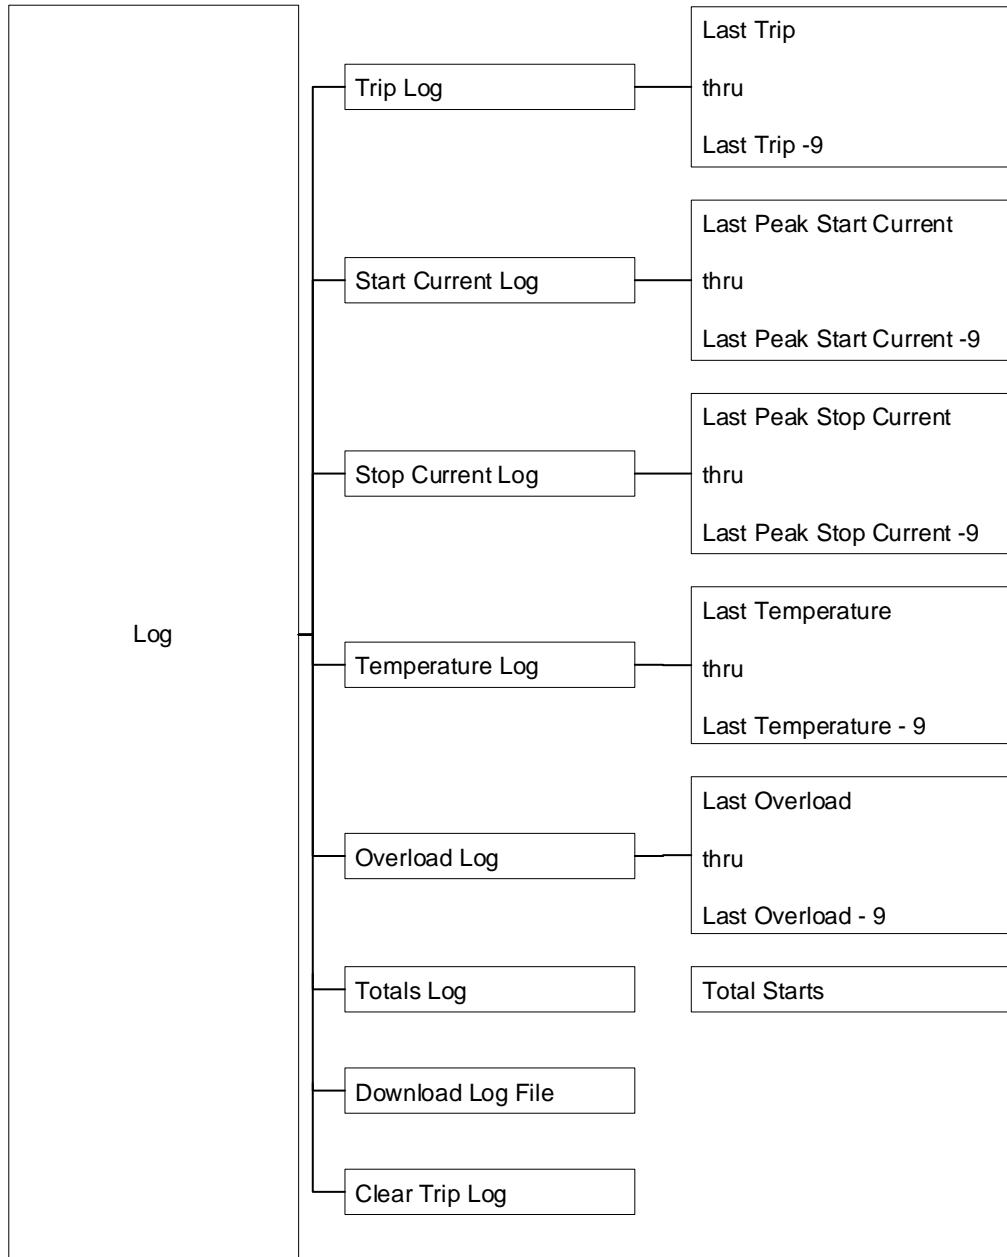

Fault Code List

| Fault Code | Description |
|----------------------|--|
| F101 - F117 | Input Side Phase Loss |
| F101 - F208 | Soft Start Temperature Trip |
| F300 - F357 | Thyristor Firing Trip |
| F401 - F403 | Motor Side Phase Loss |
| F601 | Control Voltage too low |
| F701 – F710 | Sensing Fault Trip (check all power connections) |
| F801 – F802 | Fan Problem |
| F1001 | Shorted Thyristor (SCR) |
| F1201 – F1202 | Current Limit Timeout Trip |
| F1301 – F1302 | Overload Trip |
| F1401 | Shearpin Trip |
| F1501 | PTC Thermistor Trip (Motor Temperature Sensor) |
| F1701 | Communications Trip |
| F1801 – F1803 | Bypass Relay Trip |
| F2001 | Remote Start is enabled (Remove Run Command and Reset) |
| F2101 – F2103 | Rotation Trip |
| F2201 – F2209 | MPU (Main Processing Unit) Trip |
| F2402 – F2406 | Main Board Trip |
| F2501 – F2581 | Touchscreen Trip |
| F2601 – F2603 | Logging Trip |


Rating Table

Minimum current ratings based on typical rated operation currents of motors for the corresponding rated operational powers

| Model Number | Amps | 208V / HP | | 240V / HP | | 480V / HP | | 600V / HP | |
|----------------|----------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| | | Shunt Bypass | Start Bypass |
| VMX-SGY-A-18 | 9-18 | 5 | 3 | 5 | 5 | 10 | 10 | 15 | 10 |
| VMX-SGY-A-28 | 14-28 | 7.5 | 7.5 | 7.5 | 7.5 | 20 | 15 | 15 | 20 |
| VMX-SGY-A-39 | 19-39 | 10 | 10 | 10 | 10 | 25 | 25 | 30 | 30 |
| VMX-SGY-A-48 | 24-48 | 15 | 10 | 15 | 15 | 30 | 30 | 40 | 30 |
| VMX-SGY-A-62 | 31-62 | 20 | 15 | 20 | 20 | 40 | 40 | 50 | 50 |
| VMX-SGY-A-78 | 39-78 | 25 | 20 | 25 | 25 | 60 | 50 | 60 | 60 |
| VMX-SGY-A-92 | 46-92 | 30 | 25 | 30 | 30 | 60 | 60 | 75 | 75 |
| VMX-SGY-A-112 | 56-112 | 30 | 30 | 40 | 30 | 75 | 75 | 100 | 75 |
| VMX-SGY-A-150 | 75-150 | 40 | 40 | 50 | 50 | 100 | 100 | 125 | 75 |
| VMX-SGY-A-160 | 80-160 | 50 | 40 | 60 | 50 | 125 | 100 | 150 | 75 |
| VMX-SGY-A-210 | 105-210 | 60 | 50 | 75 | 60 | 150 | 150 | 200 | 150 |
| VMX-SGY-A-275 | 138-275 | 75 | 60 | 100 | 75 | 200 | 150 | 200 | 150 |
| VMX-SGY-A-361 | 181-361 | 125 | 75 | 125 | 125 | 300 | 250 | 350 | 300 |
| VMX-SGY-A-450 | 225-450 | 150 | 125 | 150 | 150 | 350 | 300 | 450 | 300 |
| VMX-SGY-A-550 | 275-550 | 150 | 150 | 200 | 200 | 450 | 400 | 500 | 500 |
| VMX-SGY-A-600 | 300-600 | 200 | 200 | 200 | 200 | 500 | 500 | 600 | 600 |
| VMX-SGY-A-862 | 431-862 | 250 | 250 | 300 | 300 | 600 | 500 | 700 | 600 |
| VMX-SGY-A-900 | 450-900 | 300 | 250 | 350 | 300 | 700 | 600 | 900 | 600 |
| VMX-SGY-A-1006 | 503-1006 | 350 | 300 | 400 | 400 | 800 | 800 | 1,000 | 900 |
| VMX-SGY-A-1250 | 625-1250 | 450 | 350 | 500 | 450 | 1,000 | 900 | 1,200 | 1,000 |

- 1) Rated operational powers in HP corresponding to FLA current rating according to UL508 and Table 430.250 of the National Electrical Code.
- 2) The FLA rating applies for a maximum surrounding air temperature of 122°F (50°C).
- 3) 690V Rated units available – Contact Factory.
- 4) Size the Soft Starter based on the actual motor nameplate FLA.
- 5) All VMX-SGY-A units rated 500% current 60 sec; Start bypass ratings allow for use of 1.15 service factor motors.
- 6) VMX-SGY-A-600 @ 480V and 600VAC is 1.0 S.F.
- 7) Control power is required for all units.
- 8) Fuses are required for 65kA SCCR on all Models

Technical Information

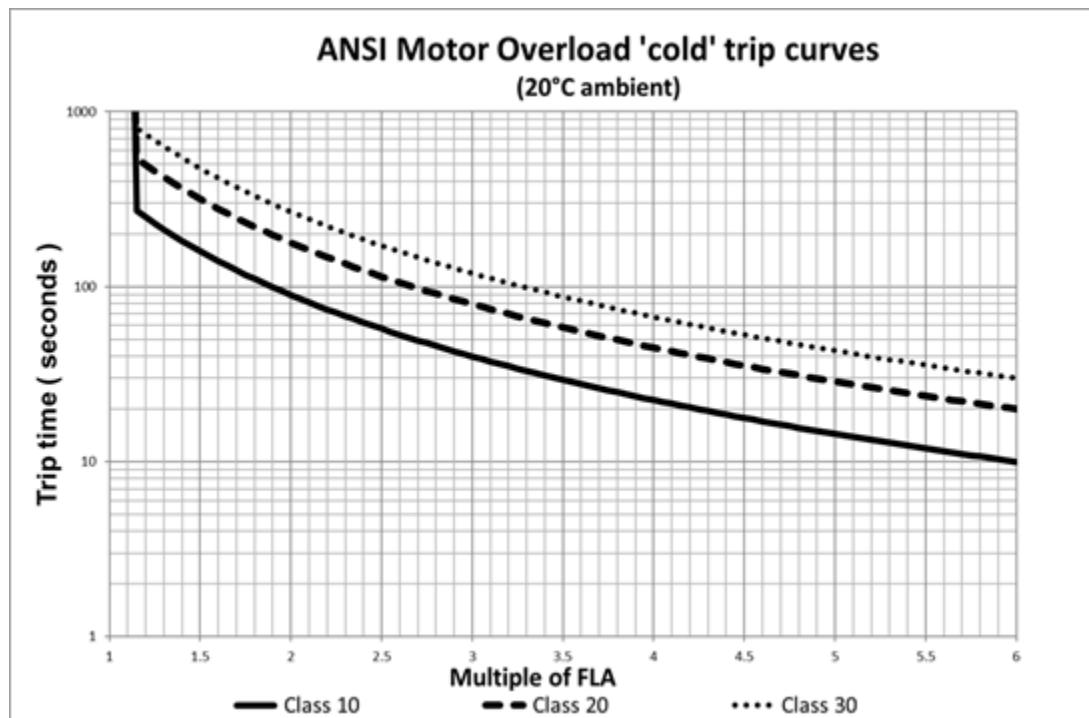

Note: When the overload has tripped, there is a forced cooling time to allow the overload to recover before the next start. The 'warm' trip times are 50% of the 'cold' trip time

Technical Information & Standards

| | | | | | | |
|---|--|---|----------------------------|--------------------------------|--|--|
| Rated operational voltages | U_e | 200VAC to 575V (600VAC maximum for UL / cUL) | | | | |
| Rated operational currents | I_e | See Rating Table | | | | |
| Rating index | | See Sizing Guide | | | | |
| Rated frequency/frequencies | | 50 - 60Hz \pm 5Hz | | | | |
| Rated duty | | Uninterrupted. | | | | |
| Form designation | | Form 1, Internally Bypassed | | | | |
| Rated insulation voltage | U_i | 600V | | | | |
| Rated impulse withstand voltage | U_{imp} | Main circuit | 6kV | | | |
| | | Control supply circuit | 4kV | | | |
| Enclosure Rating | | Main circuit | Open chassis / Panel Mount | | | |
| | | Supply and Control circuit | | | | |
| Overvoltage Category/Pollution Degree | | III/3 | | | | |
| Rated conditional short-circuit current and type of co-ordination with associated short circuit protective device (SCPD) | | Type 1 co-ordination See Short Circuit Protection Tables in user manual for rated conditional short-circuit current and required current rating and characteristics of the associated SCPD | | | | |
| Rated control circuit voltage (programmable) | U_c | 120VAC 240VAC (Optional) | 50 - 60Hz \pm 5Hz | Protect with 4A UL Listed fuse | | |
| Rated control supply voltage | U_s | See Rating Table, 2 Amp supply (cont.) | | | | |
| Relay specification | RELAY GROUP 1 | AC-15, 240VAC, 1A | | | | |
| | RELAY GROUP 2 | DC-13 30VDC, 0.7A | | | | |
| Electronic Overload relay with manual reset | RELAY GROUP 3 | AC-15, 250VAC, 3A | | | | |
| | | DC-13 24VDC, 2A | | | | |
| | Trip Class | 10, 20 or 30 (See Sizing Guide for associated I_e rating) | | | | |
| | Current setting | 10% or rated current | | | | |
| EMC Immunity levels | Rated frequency | 50 to 60Hz \pm 5Hz | | | | |
| | Time-current characteristics | See user manual. | | | | |
| EMC Emission levels | EN 55011 | Class A | | | | |
| IEC 61000-4-2 | 8kV/air discharge or 4kV/contact discharge | | | | | |
| | IEC 61000-4-3 | 10 V/m | | | | |
| | IEC 61000-4-4 | 2kV/5kHz (main and power ports) | | | | |
| | | 1kV/5kHz (signal ports) | | | | |
| | IEC 61000-4-5 | 2kV line-to-ground / 1kV line-to-line | | | | |
| | IEC 61000-4-6 | 10V | | | | |

NOTICE: This product has been designed for environment A. Use of this product in environment B may cause unwanted electromagnetic disturbances, in which case the user may be required to take adequate mitigation measures

Altitude



-4°F (-20°C) to 122°F (50°C).



Altitude above sea level 3281ft (1000m). Above 3281ft de rate by 1% of VMX-Synergy Plus™ le per 328ft (100m) to a maximum altitude of 6532ft (2000m)

Please note for higher temperatures and altitudes contact your supplier.

VMX-Synergy Plus™ models are listed CE, UL508 and cUL508.

- (en) **Electric current! Danger to life!**
Only skilled or instructed persons may carry out the operations.
- (de) **Lebensgefahr durch Strom!**
Nur Elektrofachkräfte und elektrotechnisch unterwiesene Personen dürfen die im Folgenden beschriebenen Arbeiten ausführen.
- (fr) **Tension électrique dangereuse!**
Seules les personnes qualifiées et averties doivent exécuter les travaux ci-après.
- (es) **iCorriente eléctrica! iPeligro de muerte!**
El trabajo a continuación descrito debe ser realizado por personas cualificadas y advertidas.
- (it) **Tensione elettrica: Pericolo di morte!**
Solo persone abilitate e qualificate possono eseguire le operazioni di seguito riportate.
- (zh) **触电危险！**
只允许专业人员和受过专业训练的人员进行下列工作。
- (ru) **Электрический ток! Опасно для жизни!**
Только специалисты или проинструктированные лица могут выполнять следующие операции.
- (nl) **Levensgevaar door elektrische stroom!**
Uitsluitelijk deskundigen in elektriciteit en elektrotechnisch geïnstrueerde personen is het toegestaan, de volgend beschreven werkzaamheden uit te voeren.
- (da) **Livsfare på grund af elektrisk strøm!**
Kun uddannede el-installatører og personer der er instruerede i elektrotekniske arbejdsopgaver, må udføre de nedenfor anførte arbejder.
- (el) **Προσοχή, κίνδυνος ηλεκτροπληξίας!**
Οι εργατές που αναφέρονται στη συνέχεια θα πρέπει να εκτελούνται μόνο από ηλεκτρολόγους και ηλεκτροτεχνίτες.
- (pt) **Perigo de vida devido a corrente eléctrica!**
Apenas electricistas e pessoas com formação electrotécnica podem executar os trabalhos que a seguir se descrevem.
- (sv) **Livsfara genom elektrisk ström!**
Endast utbildade elektriker och personer som undervisats i elektroteknik får utföra de arbeten som beskrivs nedan.
- (fi) **Hengenvaarallinen jännite!**
Vain pätevät sähköasentajat ja opastusta saaneet henkilöt saavat suorittaa seuraavat työt.
- (cs) **Nebezpečí úrazu elektrickým proudem!**
Niži uvedené práce směří provádět pouze osoby s elektrotechnickým vzděláním.
- (et) **Eluohutlik Elektrilöögiõht!**
Järgnevalt kirjeldatud töid tohib teostada ainult elektriaala spetsialist või elektrotehnilise instrueerimise läbinud personal.
- (hu) **Életveszély az elektromos áram révén!**
Csak elektromos szakemberek és elektrotechnikában képzett személyek végezhetik el a következőkben leírt munkákat.
- (lv) **Elektriskā strāva apdraud dzīvību!**
Tālāk aprakstītos darbus drīkst veikt tikai elektrospeciālisti un darbam ar elektrotehniskām iekārtām instruētās personas!
- (lt) **Pavojas gyvybei dėl elektros srovės!**
Tik elektrikai ir elektrotechnikos specialistai gali atlikti žemiau aprašytus darbus.
- (pl) **Porażenie pradem elektrycznym stanowi zagrożenie dla życia!**
Opisane poniżej prace mogą przeprowadzać tylko wykwalifikowani elektrycy oraz osoby odpowiednio poinstruowane w zakresie elektrotechniki.
- (sl) **Življenska nevarnost zaradi električnega toka!**
Spodaj opisana dela smejo izvajati samo elektrostrokovnjaki in elektrotehnično poučene osebe.
- (sk) **Nebezpečenstvo ohrozenia života elektrickým prúdom!**
Práce, ktoré sú nižšie opísané, smú vykonávať iba elektrooborníci a osoby s elektrotechnickým vzdelením.
- (bg) **Опасност за живота от електрически ток!**
Операциите, описани в следващите раздели, могат да се извършват само от специалисти-електротехники и инструктирани електротехнически персонал.
- (ro) **Atenție! Pericol electric!**
Toate lucrările descrise trebuie efectuate numai de personal de specialitate calificat și de persoane cu cunoștințe profunde în electrotehnica.

California Customers: California Proposition 65 Warning

WARNING: this product and associated accessories may contain chemicals known to the State of California to cause cancer, birth defects, or other reproductive harm. For more information visit <https://p65warnings.ca.gov>



MOTORTRONICS™

Solid State AC Motor Control

VMX-Synergy Plus™

Premium Digital Soft Starter

www.motortronics.com